
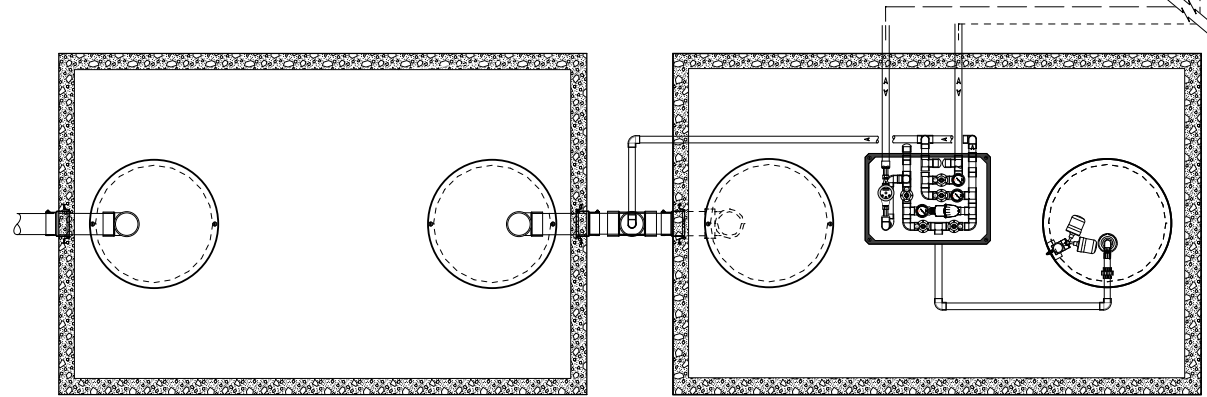



OSCAR-II-Tanks

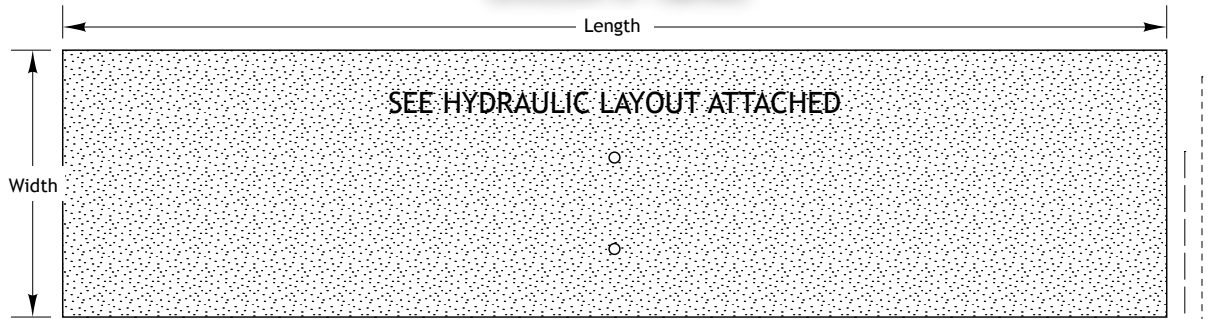

PLAN VIEW

Treatment Vessel

1000 Gallon Pre-cast Concrete Single Compartment Discharge Tank

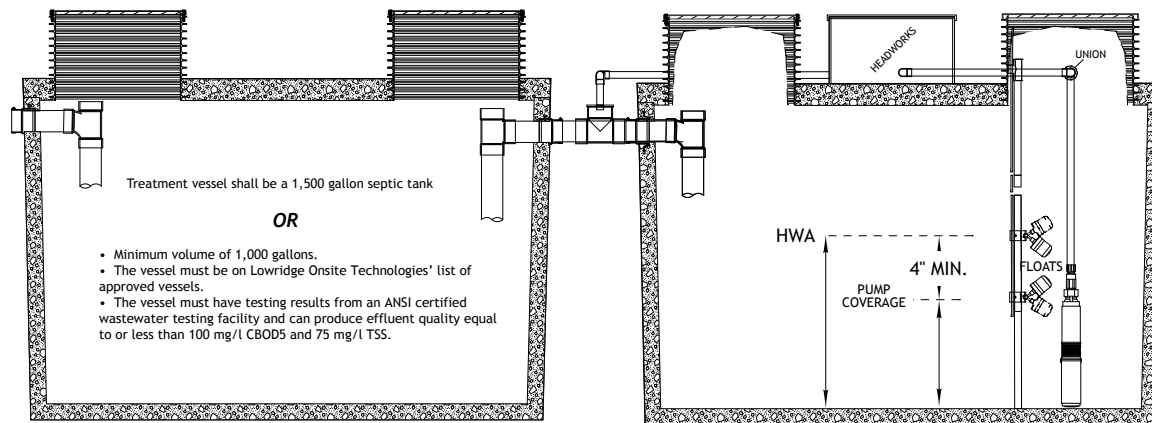

CROSS SECTION

Treatment vessel shall be a 1,500 gallon septic tank

OR

- Minimum volume of 1,000 gallons.
- The vessel must be on Lowridge Onsite Technologies' list of approved vessels.
- The vessel must have testing results from an ANSI certified wastewater testing facility and can produce effluent quality equal to or less than 100 mg/l CBOD5 and 75 mg/l TSS.

LOWRIDGE ONSITE TECHNOLOGIES

DRAWING ID: OS-II-Tanks

SCALE: NTS

DRAWN BY: DBM

CK BY: DAVE LOWE

DATE: 01.29.2019